

32.80"

CABLE ENTRY AREA

24.75"

24.75

CABLE ENTRY AREA

LEFT SIDE VIEW

5.82"

- 5.82"


Ø 0.75" MOUNT HOLES (4x) 23.78" 90821 SERIES MAINTENANCE BYPASS BREAKER CABINET 15-400A, 208V/240V/480V, 3Ø 3W OR 4W, 3 BREAKER INTERLOCK CONFIGURATION 2 THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF C&C POWER, INC. ANY REPRODUCTION WITHOUT THE WRITTEN CONSENT OF C&C POWER, INC IS PROHIBITED. C&C POWER DIMENSIONS ARE IN INCHES INITIALS TOLERANCES: DRAWN' OI DATE ENGINEERED POWER PRODUCTS - 1.56" DRAWN' CH 5/3/2018 WWW.CCPOWER.COM DECIMALS: ANGLES: .XX ±.13 ±1° ±1° CHECKED CH © 2018 C&C POWER, INC. 5/3/2018 BOTTOM VIEW .XXX ±.062 NTS SIZE: A REV: 1 SHEET 1 OF 2 ALL RIGHTS RESERVED

NOTES:

DRAWING #:

- 3.
- -SD01-1 REV 1
 - 4.
- 5.

- C2-3BK 6.
- 90821-
 - 7.
 - FLOOR MOUNTING HARDWARE.
- 8. THE EQUIPMENT IS CERTIFIED TO THE INTERNATIONAL BUILDING CODE (IBC) AND THE CALIFORNIA BUILDING CODE (CBC) TO MEET SEISMIC DESIGN CATEGORY F, SS = 2.00 AND IMPORTANCE FACTOR 1.5.



CABLE

ENTRY


- 8.88" -

2.50"


27.80"


1.56"


2.50"



- 12.00" --

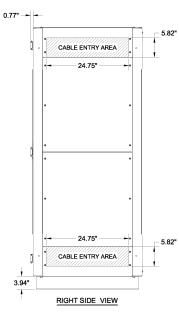


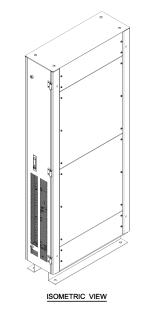



CIRCUIT BREAKER OPTIONS				
TRIP SIZE	TRIP TYPE	AIC @ 240V	AIC @ 480	
15-100A	TMAG (80%)	18K OR 65K	N/A	
110-225A	TMAG (80%)	22K OR 65K	N/A	
15-150A	TMAG (80%)	N/A	14K OR 65K	
175-225A	TMAG (80%)	N/A	35K OR 65K	
250A	TMAG (80%)	65K	35K OR 65K	
300A	TMAG (80%)	65K	35K OR 65K	
350A	TMAG (80%)	65K	35K OR 65K	
400A	TMAG (80%)	65K	35K OR 65K	
40-100A (ADJUSTABLE)	LI OR LSI (80% 210+)	65K	35K OR 65K	
70-150A (ADJUSTABLE)	LI OR LSI (80% 210+)	65K	35K OR 65K	
100-225A (ADJUSTABLE)	LI OR LSI (80% 210+)	65K	35K OR 65K	
15-80A (ADJUSTABLE)	LS, LSI, LSG, LSIG (80% 310+)	65K	35K OR 65K	
60-160A (ADJUSTABLE)	LS, LSI, LSG, LSIG (80% 310+)	65K	35K OR 65K	
100-225A (ADJUSTABLE)	LS, LSI, LSG, LSIG (80% 310+)	65K	35K OR 65K	
160-400A (ADJUSTABLE)	LS, LSI, LSG, LSIG, ALSI, ALSIG (80% OR 100%)	65K	35K OR 65K	

CIRCUIT BREAKER TERMINAL INFO			
TRIP SIZE	WIRE RANGE		
15-100A	(1) 14 - 1/0		
110-225A	(1) 4 - 4/0		
250A	(1) 4 - 350		
300-350A	(1) 250 - 500		
400A	(2) 3/0 - 250		

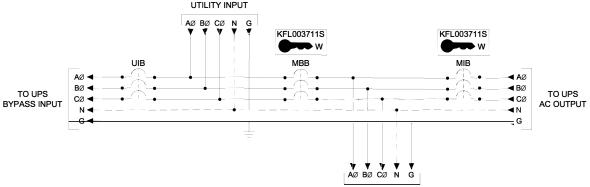

OUTPUT TO LOAD

NTS SIZE: A REV: 1

NOTES:

- "UIB" UPS INPUT BREAKER 1.
- "MBB" MAINTENANCE BYPASS BREAKER 2.
- "MIB" MAINTENANCE ISOLATION BREAKER 3.
- 4. ALL INTERNAL CONNECTIONS BETWEEN "UIB", "MBB" AND "MIB" CIRCUIT BREAKERS ARE MADE USING COPPER BUS BARS.
- 5. OPTIONAL 600A RATED NEUTRAL BUS PROVIDED WITH MECHANICAL LUGS THAT ACCEPT A TOTAL OF (4) #6 - 350 MCM CABLES.
- 5. OPTIONAL 800A RATED NEUTRAL BUS PROVIDED WITH MECHANICAL LUGS THAT ACCEPT A TOTAL OF (8) #2 - 600 MCM CABLES.
- GROUND LUG ACCEPTS (4) #6 350 MCM CABLES. 6.
- SD0 1-2 REV 1 MECHANICAL LUGS USED FOR THE AØ, BØ, AND CØ ON THE UTILITY INPUT & THE 7. OUTPUT LOAD HAVE THE SAME WIRE RANGE AS THE CIRCUIT BREAKERS.
- THIS DRAWING IS TO BE USED FOR ELECTRICAL PURPOSES ONLY AND DOES NOT 8. REPRESENT THE ACTUAL MECHANICAL LAYOUT OF THE EQUIPMENT.

KIRK KEY NOTES:

BK-

9082

RAWING #: 9

- 1. THE "E" OR "W" NEXT TO THE INTERLOCK INDICATES THE POSITION OF THE INTERLOCK
- BOLT WHEN THE KEY IS REMOVABLE. "E" = EXTENDED AND "W" = WITHDRAWN.
- THE KEY OR KEYS NEXT TO THE INTERLOCK INDICATES THE KEY NUMBER THAT 2. FUNCTIONS WITH THE INTERLOCK.

90821 SERIES MAINTENANCE BYPASS BREAKER CABINET 15-400A, 208V/240V/480V, 3Ø 3W OR 4W, 3 BREAKER INTERLOCK CONFIGURATION 2 THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF C&C POWER, INC. ANY REPRODUCTION WITHOUT THE WRITTEN CONSENT OF C&C POWER, INC IS PROHIBITED. C&C POWER DIMENSIONS ARE IN INCHES INITIALS TOLERANCES: DRAWN DATE ENGINEERED POWER PRODUCTS DRAWN CH WWW.CCPOWER.COM 5/3/2018 DECIMALS: ANGLES: CHECKED CH .XX ±.13 .XXX ±.062 ±1° 5/3/2018 © 2018 C&C POWER, INC.

ALL RIGHTS RESERVED

SHEET 2 OF 2