

**NOTES:**


1. APPROXIMATE WEIGHT: 100 LBS.
2. ASSEMBLY IS UL/CUL LISTED TO UL 891 AND C22.2 NO. 244.
3. NEMA 1 WALL MOUNT ENCLOSURE.
4. THE BOX & TRIM ARE CONSTRUCTED FROM GALVANIZED STEEL.
5. THE TRIM FINISH IS POWDER COATED ON ALL EXTERNAL AND VISIBLE SURFACES, BOX AND ALL INTERNAL MOUNT BRACKETS ARE GALVANIZED FINISH.
6. THE CABINET IS TO BE MOUNTED THROUGH THE Ø0.375" HOLES IN THE BACK OF THE ENCLOSURE.

<b>90880 SERIES MAINTENANCE BYPASS BREAKER PANEL</b>			
<b>15-225A, 208V/240V/480V, 3Ø 3W OR 4W, 3 BREAKER</b>			
<b>INTERLOCK CONFIGURATION 2</b>			
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF C&C POWER, INC. ANY REPRODUCTION WITHOUT THE WRITTEN CONSENT OF C&C POWER, INC IS PROHIBITED.			
DIMENSIONS ARE IN INCHES	INITIALS	DATE	
TOLERANCES:	DRAWN ABB	07/27/2018	
DECIMALS: .13	ANGLES: ±1°	CHECKED ABB	07/27/2018
.XXX ±.002			
SCALE: SIZE A	REV: 1	SHEET 1 OF 2	
NTS		<b>C&amp;C POWER</b> ENGINEERED POWER PRODUCTS WWW.CCPOWER.COM © 2018 C&C POWER, INC. ALL RIGHTS RESERVED	

**CIRCUIT BREAKER OPTIONS**

TRIP SIZE	TRIP TYPE	AIC @ 240V	AIC @ 480V
15-100A	TMAG (80%)	18K OR 65K	N/A
110-225A	TMAG (80%)	22K OR 65K	N/A
15-150A	TMAG (80%)	N/A	14K OR 65K
175-225A	TMAG (80%)	N/A	35K OR 65K
40-100A (ADJUSTABLE)	LI OR LSI (80% 210+)	65K	35K OR 65K
70-150A (ADJUSTABLE)	LI OR LSI (80% 210+)	65K	35K OR 65K
100-225A (ADJUSTABLE)	LI OR LSI (80% 210+)	65K	35K OR 65K
15-80A (ADJUSTABLE)	LS, LSI, LSG, LSIG (80% 310+)	65K	35K OR 65K
60-160A (ADJUSTABLE)	LS, LSI, LSG, LSIG (80% 310+)	65K	35K OR 65K
100-225A (ADJUSTABLE)	LS, LSI, LSG, LSIG (80% 310+)	65K	35K OR 65K

CIRCUIT BREAKER TERMINAL INFO	
TRIP SIZE	WIRE RANGE
15-100A	(1) 14 - 1/0
110-225A	(1) 4 - 4/0

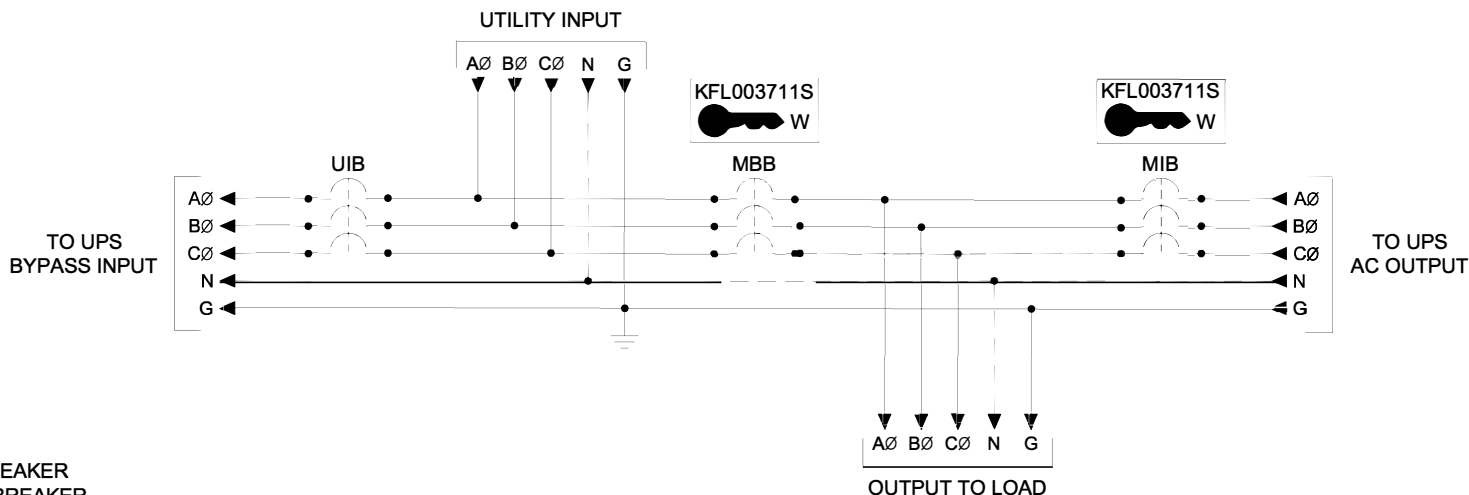

**NOTES:**

- "UIB" UPS INPUT BREAKER
- "MBB" MAINTENANCE BYPASS BREAKER
- "MIB" MAINTENANCE ISOLATION BREAKER
- ALL INTERNAL CONNECTIONS BETWEEN "UIB", "MBB" AND "MIB" CIRCUIT BREAKERS ARE MADE USING COPPER BUS BARS.
- OPTIONAL 600A RATED NEUTRAL BUS PROVIDED WITH MECHANICAL LUGS THAT ACCEPT A TOTAL OF (4) #6 - 350 MCM CABLES.
- GROUND LUG ACCEPTS (3) #6 - 350 MCM CABLES.
- MECHANICAL LUGS USED FOR THE AØ, BØ, AND CØ ON THE UTILITY INPUT & THE OUTPUT LOAD HAVE THE SAME WIRE RANGE AS THE CIRCUIT BREAKERS.
- THIS DRAWING IS TO BE USED FOR ELECTRICAL PURPOSES ONLY AND DOES NOT REPRESENT THE ACTUAL MECHANICAL LAYOUT OF THE EQUIPMENT.

**KIRK KEY NOTES:**

- THE "E" OR "W" NEXT TO THE INTERLOCK INDICATES THE POSITION OF THE INTERLOCK BOLT WHEN THE KEY IS REMOVABLE. "E" = EXTENDED AND "W" = WITHDRAWN.
- THE KEY OR KEYS NEXT TO THE INTERLOCK INDICATES THE KEY NUMBER THAT FUNCTIONS WITH THE INTERLOCK.

90880 SERIES MAINTENANCE BYPASS BREAKER PANEL			
15-225A, 208V/240V/480V, 3Ø 3W OR 4W, 3 BREAKER			
INTERLOCK CONFIGURATION 2			
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF C&C POWER, INC. ANY REPRODUCTION WITHOUT THE WRITTEN CONSENT OF C&C POWER, INC IS PROHIBITED.			
DIMENSIONS ARE IN INCHES	INITIALS	DATE	
TOLERANCES:	DRAWN	ABB	07/27/2018
DECIMALS: .13	ANGLES:	±1°	
XXX 1.062	CHECKED	ABB	07/27/2018
SCALE: SIZE: A	REV: 1	SHEET 2 OF 2	
NTS		<p><b>C&amp;C POWER</b> ENGINEERED POWER PRODUCTS WWW.CCPOWER.COM</p> <p>© 2018 C&amp;C POWER, INC. ALL RIGHTS RESERVED</p>	