

REAR VIEW

FRONT VIEW (DOOR REMOVED)

RIGHT SIDE VIEW

## NOTES:

- 1. APPROXIMATE WEIGHT: 55 LBS
- 2. ASSEMBLY IS UL/CUL LISTED TO UL 891 AND C22.2 NO. 244.
- 3. NEMA 1 WALL MOUNT ENCLOSURE.
- 4. THE BOX & TRIM ARE CONSTRUCTED OF GALVANIZED STEEL.
- THE TRIM FINISH IS POWDER COATED ON ALL EXTERNAL AND VISIBLE SURFACES, BOX AND ALL INTERNAL MOUNT BRACKETS ARE GALVANIZED FINISH.
- 6. THE PANEL IS PROVIDED WITH A KEY LOCKING PUSH TO CLOSE LATCH ON THE ACCESS COVER.
- 7. THE PANEL IS TO BE MOUNTED THROUGH THE Ø0.375" HOLES IN THE BACK OF THE ENCLOSURE.

90885 SERIES WALL MOUNT MAINTENANCE BYPASS PANEL 15A-225A, 208Y/120V, 3Ø/4W/G, 3 BREAKER

**INTERLOCK CONFIGURATION 13** 

NTS SIZE: A REV: 2


THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF GAS COWER, INC. ANY REPRODUCTION WITHOUT THE WRITTEN CONSENT OF GAC POWER, INC IS PROHIBITED.

DIMENSIONS ARE IN INCHES TOLERANCES:
DIMENALS: ANGLES:
XX ± 13 ±1°
XXX ± 082

CRECKED CH 124/2015

## C&C POWER ENGINEERED POWER PRODUCTS WWW.CCPOWER.COM

© 2015 C&C POWER, INC. ALL RIGHTS RESERVED

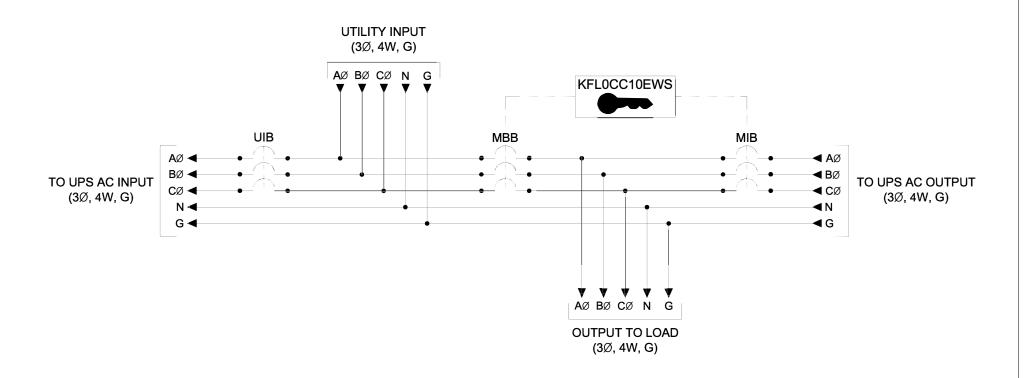

## NOTES:

- 1. "UIB" UPS INPUT BREAKER
- 2. "MBB" MAINTENANCE BYPASS BREAKER
- 3. "MIB" MAINTENANCE ISOLATION BREAKER
- 4. 450A RATED NEUTRAL BUS PROVIDED WITH MECHANICAL LUGS THAT ACCEPT A TOTAL OF (4) #6 350 MCM CABLES.
- 5. GROUND LUG ACCEPTS (3) #6 350 MCM CABLES.
- 6. MECHANICAL LUGS USED FOR THE UTILITY INPUT & THE OUTPUT TO LOAD HAVE THE SAME WIRE RANGE AS THE CIRCUIT BREAKERS.
- 7. THIS DRAWING IS TO BE USED FOR ELECTRICAL PURPOSES ONLY AND DOES NOT REPRESENT THE ACTUAL MECHANICAL LAYOUT OF THE EQUIPMENT.

## 90885 SERIES WALL MOUNT MAINTENANCE BYPASS PANEL 15A-225A, 208Y/120V, 3Ø/4W/G, 3 BREAKER INTERLOCK CONFIGURATION 13 THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CAC POWER, INC. ANY REPRODUCTION WITHOUT THE WRITTEN CONSENT OF CAC POWER, INC. IS PROHIBITED. DIMENSIONS ARE IN INCHES. DIAMIN PJC 5721/2013 XX ± 13 XX ± 1