

# **HRC950**

- Exclusive Compu-Press grid technology optimizes energy transfer to maximize high rate power
- · Advanced AGM technology for superior high-rate power
- Puncture resistant micro-porous glass mat separators extend life
- Reinforced case resists bulging and meets safety requirements (UL 94 V-0)
- Case & cover heat sealed and 100% tested to prevent leaks
- · Epoxy sealed posts eliminate leaks
- Flame arresting, low-pressure, self-sealing valves are 100% factory tested
- Computer-aided design and manufacturing control processes and standards to ensure quality products
- All batteries meet or exceed IEEE recommended practices
- · Battery design and construction meet UL recognition requirements
- · Plate thickness optimized for long life
- Guaranteed 100% initial string capacity when tested in accordance with IEEE 1188

### **SPECIFICATIONS**

Nominal Voltage: 12-Volts Safety Vent: Low positive pressure,

Rating: 550 Watts/Cell @ 15 min. rate self-sealing w/ flame arrestor

to 1.67 V.P.C. Float Voltage: 2.25 V.P.C. ± 0.01 V.P.C. @ 77°F (25°C)

Positive Plate: >98% Pure lead with tin-calcium alloy

Design life: 10 years in float applications @ 77°F (25°C)

Negative Plate: Pure lead, calcium alloy Dimensions: Length - 13.46" (341.9 mm)


Post Seal: Epoxy-sealed Width - 6.84" (173.7 mm)

Tarminal: Tan access 1/4" 20 threaded inpart


Height 11 21" (284.7 mm)

**Terminal:** Top access, 1/4" – 20 threaded insert Height - 11.21" (284.7 mm)

Case/Cover: Flame-retardant, polypropylene – Weight: 105.5 lbs. (48 kg)

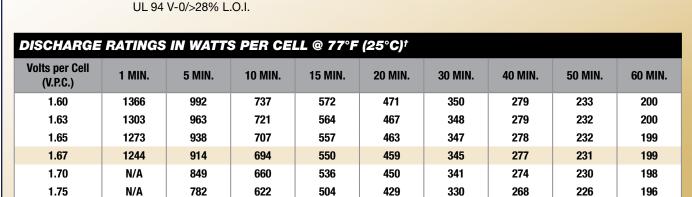

†Subject to change without notice.

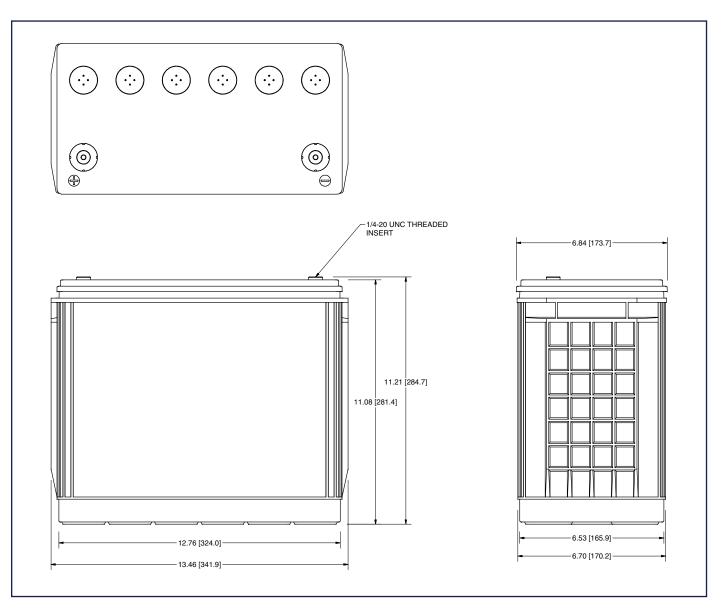

#### OPTIONAL FACTORY ACCEPTANCE TESTING

- · More economical than performing a load test on site
- · Confirms published capacity rating of product
- · Establishes a factory baseline ohmic reading
- · Formal test report provided
- Contact your East Penn Mfg. representative for additional information

#### **TESTING SPECIFICATIONS**

- · Exceeds IEEE-1188 standards
- 10 minute battery rate to 1.67 V.P.C.
- Constant power discharge
- String ≥ 100% capacity All individual batteries ≥ 95% capacity
- Conductance readings taken before the test
- Battery voltage recorded on report every 2 minutes

## **INSTALLATION AND OPERATING INSTRUCTIONS**

www.eastpennmanufacturing.com/wp-content/uploads/HRC-IO-Manual-2531.pdf

PROPOSITION 65 WARNING: Battery posts, terminals and related accessories contain lead and lead compounds, chemicals known to the State of California to cause cancer and reproductive harm. Batteries also contain other chemicals known to the State of California to cause cancer. WASH HANDS AFTER HANDLING.





www.dekabatteries.com

QUALITY SYSTEM **ISO 9001 IATF 16949 ISO 14001** 

Fax: 610-682-0891



